



8165 E Kaiser Blvd. Anaheim, CA 92808
www.lightlaboratory.com

Report No: L022111002



Report No: L022111002

Issue Date: 2/22/2021

Report Prepared For: Light and Green
2340 E Olympic Blvd. Unit E., Los Angeles, CA 90021

Model Number: LG-1037-27K

Test: Photometric/Electrical Test

Standards Used: Appropriate part or all test guidelines were used for test performed:

IESNA LM79: 2008 Approved Methods for Electrical and Photometric Measurements of Solid-State Lighting Products

ANSI NEMA ANSLG C78.377: 2008 Specification of the Chromaticity of Solid State Lighting Products

ANSI C82.77:2002: Harmonic Emission Limits-Related Quality Requirements for Lighting Equipment

Description of Sample: Client submitted the sample. Received in working and undamaged condition. No modifications were necessary.

Special Test Condition: Fixture is tested with no special conditions.

Sample Arrival Date: 2/8/21

Date of Tests: 2/15/21 - 2/22/21

Seasoning of Sample: No seasoning was performed in accordance with IESNA LM-79.

Equipment List

Equipment Used	Model No	Stock No	Calibration Due Date
Chroma Programmable AC Source	61604	PS-AC02	--
Yokogawa Digital Power Meter	WT210	MT-EL06-S4	1/9/22
BK PRECISION	1747	PS-DC04	1/10/22
Fluke Digital Thermometer	52K/J	MT-TP05	1/10/22
LLI Type C Goniophotometer System	RMG-C-MKII	CD-LL04-GC	--
LLI 2M Sphere	2MR97	CD-SN03-S2	--
LLI Spectroradiometer	SPR-3000	MT-SC01-S2	Before Use

General Information

Manufacturer:	Light and Green
Model Number:	LG-1037-27K
Driver Model Number:	ERP EBR020U-0500-42

Photometric & Electrical Test Results

Total Lumens:	1144.16
Efficacy:	56.36
Input Voltage (VAC/60Hz):	120.02
Input Current (Amp):	0.1705
Input Power (W):	20.30
Input Power Factor:	0.9919
Current ATHD (%):	10.2%

Test Condition

Ambient Temperature (°C):	25.0
Stabilization Time (Hours):	0:35
Total Operating Time (Hours):	1:20

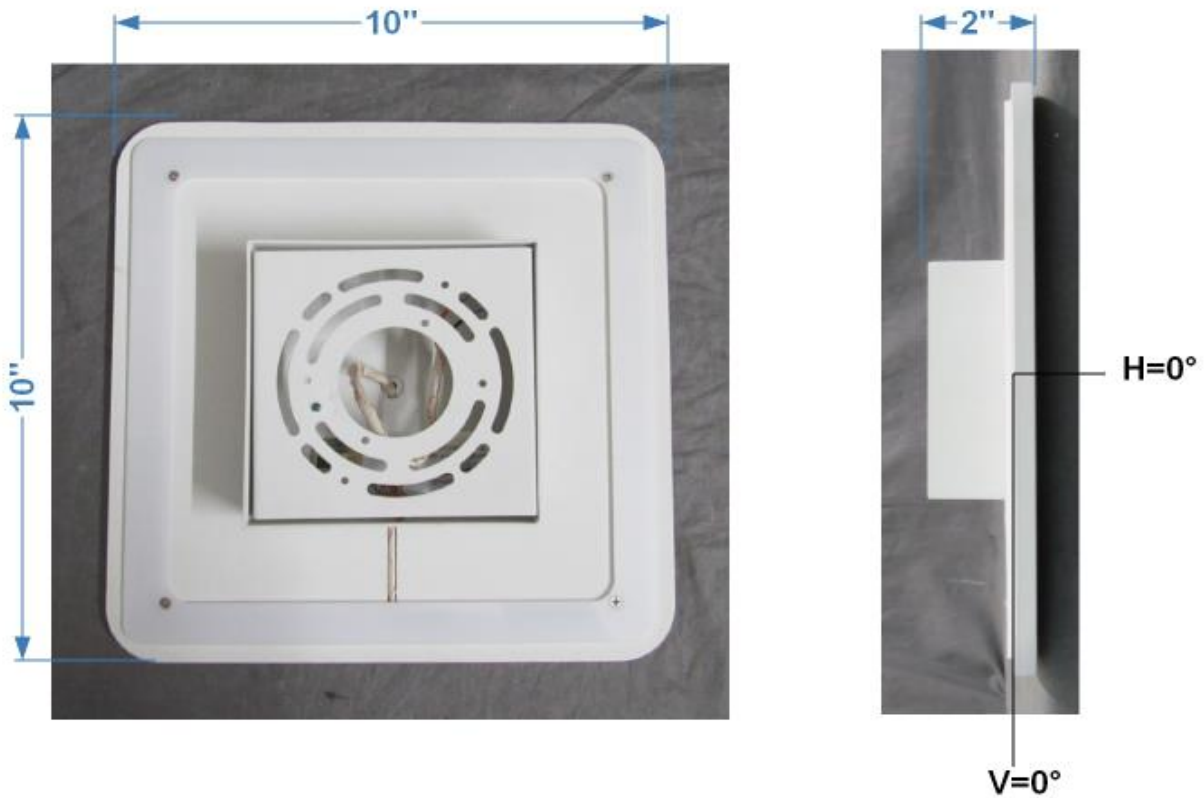


FIG. 1 LUMINAIRE



8165 E Kaiser Blvd. Anaheim, CA 92808
www.lightlaboratory.com

Report No: L022111002



Test Methods

Photometric Measurements - Goniophotometer

A Custom Light Laboratory Type C Rotating Mirror Goniophotometer was used to measure candelas(intensity) at each angle of distribution as defined by IESNA for the appropriate fixture type.

Ambient temperature is set to 25°C and is measured from the center of the fixture, within 1ft from the outside of the fixture. Temperature is maintained at 25°C throughout the testing process and the sample is stabilized for at least 30mins and longer as necessary for the sample to achieve stabilization.

Electrical measurements are measured using the listed equipment.

Spectral Measurements - Integrating Sphere

A Sensing Spectroradiometer SPR-3000, in conjunction with Light Laboratory 2 meter integrating sphere was used to measure chromaticity coordinates, correlated color temperature(CCT) and the color rendering index(CRI) for each sample.

Ambient temperature is set to 25°C and is measured from the center of the fixture, within 1ft from the outside of the fixture. Temperature is maintained at 25°C throughout the testing process and the sample is stabilized for at least 30mins and longer as necessary for the sample to achieve stabilization.

Electrical measurements are measured using the listed equipment.

Disclaimers:

This report must not be used by the customer to claim product certification, approval or endorsement by NVLAP, NIST or any agency of Federal Government.

Report Prepared by : Keyur Patel

Test Report Reviewed by:

Steve Kang
Quality Assurance

**Attached are photometric data reports. Total number of pages: 11*



8165 E. Kaiser Blvd. Anaheim, CA 92808
www.lightlaboratory.com

Photometric Test Report

IES INDOOR REPORT

PHOTOMETRIC FILENAME : L022111002.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002
[TEST] L022111002
[TESTLAB] LIGHT LABORATORY, INC. (www.lightlaboratory.com)
[ISSUEDATE] 2/22/2021
[MANUFAC] Light and Green
[LUMCAT] LG-1037-27K
[LUMINAIRE] Surface Mount Wall Sconce
[BALLASTCAT] ERP EBR020U-0500-42
[OTHER] INDICATING THE CANDELA VALUES ARE ABSOLUTE AND
[MORE] SHOULD NOT BE FACTORED FOR DIFFERENT LAMP RATINGS.
[INPUT] 120.02VAC, 20.30W
[TEST PROCEDURE] IESNA:LM-79-08

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	1144
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	56
Total Luminaire Watts	20.3
Ballast Factor	1.00
CIE Type	General Diffuse
Spacing Criterion (0-180)	N.A.
Spacing Criterion (90-270)	N.A.
Spacing Criterion (Diagonal)	N.A.
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	0.01 ft
Luminous Width (90-270)	0.77 ft
Luminous Height	0.77 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	104	121	12018
55	96	112	12154
65	88	107	12517
75	81	105	13182
85	79	104	14658

IES INDOOR REPORT
PHOTOMETRIC FILENAME : L022111002.IES

CANDELA TABULATION

	<u>0</u>	<u>5</u>	<u>10</u>	<u>15</u>	<u>20</u>	<u>25</u>	<u>30</u>	<u>35</u>	<u>40</u>	<u>45</u>
0	11.18	11.18	11.18	11.18	11.18	11.18	11.18	11.18	11.18	11.18
5	9.47	9.49	9.52	9.57	9.63	9.70	9.78	9.88	9.99	10.10
10	8.00	8.03	8.09	8.17	8.26	8.39	8.53	8.69	8.87	9.08
15	6.60	6.63	6.69	6.78	6.91	7.06	7.25	7.48	7.74	8.02
20	5.31	5.33	5.39	5.50	5.63	5.80	6.01	6.25	6.51	6.88
25	4.40	4.42	4.48	4.55	4.65	4.78	4.93	5.12	5.43	5.80
30	3.49	3.51	3.56	3.65	3.77	3.92	4.09	4.28	4.54	4.82
35	3.60	3.60	3.59	3.56	3.51	3.45	3.42	3.64	3.80	4.02
40	3.84	3.83	3.81	3.77	3.72	3.65	3.58	3.50	3.45	3.52
45	4.09	4.09	4.06	4.01	3.93	3.85	3.77	3.67	3.56	3.44
50	4.30	4.25	4.23	4.18	4.10	4.03	3.93	3.82	3.71	3.58
55	4.37	4.36	4.33	4.29	4.23	4.16	4.08	3.96	3.83	3.68
60	4.40	4.42	4.39	4.35	4.32	4.26	4.18	4.08	3.94	3.78
65	4.44	4.42	4.41	4.39	4.38	4.33	4.26	4.16	4.03	3.86
70	4.40	4.40	4.41	4.42	4.41	4.38	4.32	4.25	4.12	3.95
75	4.33	4.37	4.39	4.43	4.44	4.41	4.37	4.29	4.18	4.01
80	4.33	4.34	4.38	4.41	4.43	4.43	4.42	4.34	4.24	4.07
85	4.33	4.35	4.36	4.39	4.44	4.44	4.43	4.38	4.28	4.11
90	4.31	4.31	4.35	4.37	4.42	4.45	4.45	4.38	4.31	4.14
95	4.33	4.34	4.34	4.38	4.42	4.44	4.43	4.38	4.30	4.11
100	4.33	4.33	4.36	4.40	4.43	4.43	4.42	4.34	4.25	4.08
105	4.33	4.36	4.39	4.41	4.42	4.41	4.37	4.29	4.19	4.02
110	4.37	4.38	4.39	4.40	4.39	4.36	4.32	4.24	4.12	3.95
115	4.40	4.40	4.38	4.38	4.36	4.32	4.25	4.15	4.02	3.86
120	4.37	4.36	4.35	4.33	4.30	4.25	4.17	4.06	3.92	3.77
125	4.33	4.32	4.30	4.28	4.23	4.16	4.06	3.93	3.81	3.67
130	4.26	4.25	4.22	4.18	4.11	4.03	3.93	3.82	3.70	3.63
135	4.12	4.11	4.08	4.03	3.96	3.88	3.83	3.72	3.69	3.68
140	3.95	3.93	3.93	3.92	3.91	3.90	3.83	3.77	3.77	3.88
145	3.95	3.96	3.95	3.92	3.87	3.81	3.80	4.02	4.19	4.41
150	3.95	3.96	4.01	4.08	4.18	4.31	4.48	4.68	4.92	5.18
155	4.79	4.80	4.86	4.93	5.03	5.16	5.31	5.51	5.80	6.16
160	5.69	5.71	5.76	5.86	5.99	6.16	6.37	6.61	6.87	7.24
165	6.92	6.95	7.01	7.11	7.24	7.40	7.59	7.82	8.09	8.37
170	8.35	8.37	8.42	8.49	8.58	8.70	8.84	9.00	9.18	9.39
175	9.71	9.73	9.77	9.81	9.86	9.91	9.98	10.05	10.13	10.22
180	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00

Vert. Horizontal Angles

	<u>50</u>	<u>55</u>	<u>60</u>	<u>65</u>	<u>70</u>	<u>75</u>	<u>80</u>	<u>85</u>	<u>90</u>	<u>95</u>
0	11.18	11.18	11.18	11.18	11.18	11.18	11.18	11.18	11.18	11.18
5	10.23	10.37	10.51	10.66	10.82	10.97	11.14	11.30	11.46	12.48
10	9.31	9.55	9.81	10.12	10.45	10.78	11.12	11.45	11.79	13.83
15	8.35	8.71	9.10	9.51	9.97	10.45	10.97	11.50	12.03	15.11
20	7.30	7.76	8.26	8.82	9.41	10.07	10.72	11.41	12.10	16.16
25	6.20	6.70	7.33	8.02	8.80	9.61	10.45	11.31	12.17	17.16
30	5.22	5.70	6.29	7.15	8.06	9.06	10.11	11.13	12.17	18.11
35	4.38	4.84	5.43	6.21	7.26	8.42	9.68	10.92	12.16	19.11
40	3.59	4.03	4.59	5.31	6.38	7.64	9.09	10.61	12.17	20.14
45	3.36	3.42	3.83	4.53	5.47	6.80	8.42	10.22	12.17	21.09
50	3.44	3.29	3.45	3.83	4.63	6.01	7.74	9.81	12.16	21.97
55	3.53	3.38	3.27	3.34	4.07	5.37	7.15	9.34	12.12	22.74
60	3.62	3.43	3.28	3.24	3.67	4.82	6.62	8.82	12.03	23.52

IES INDOOR REPORT
PHOTOMETRIC FILENAME : L022111002.IES

CANDELA TABULATION - (Cont.)

65	3.68	3.48	3.31	3.18	3.40	4.39	6.16	8.29	11.91	24.17
70	3.75	3.54	3.34	3.16	3.23	4.14	5.81	7.69	11.74	24.86
75	3.80	3.57	3.36	3.18	3.14	4.00	5.60	7.26	11.56	25.49
80	3.84	3.61	3.39	3.20	3.08	4.01	5.48	6.97	11.49	25.95
85	3.85	3.61	3.40	3.19	3.04	4.13	5.46	6.73	11.37	25.85
90	3.86	3.62	3.41	3.20	3.02	4.28	5.59	6.64	11.21	25.08
95	3.85	3.63	3.39	3.19	3.04	4.18	5.55	6.90	11.47	25.24
100	3.84	3.61	3.39	3.20	3.08	4.06	5.60	7.30	11.77	25.53
105	3.80	3.57	3.37	3.18	3.15	4.08	5.90	7.62	12.05	25.55
110	3.75	3.54	3.34	3.17	3.27	4.27	6.17	8.07	12.33	25.13
115	3.68	3.50	3.31	3.23	3.56	4.70	6.47	8.62	12.56	24.63
120	3.60	3.43	3.27	3.40	3.95	5.16	6.96	9.19	12.68	24.04
125	3.53	3.44	3.44	3.64	4.40	5.73	7.49	9.68	12.66	23.40
130	3.55	3.51	3.76	4.19	4.95	6.34	8.04	10.10	12.57	22.67
135	3.65	3.76	4.21	4.89	5.78	7.07	8.66	10.44	12.40	21.79
140	3.98	4.41	4.96	5.64	6.68	7.88	9.27	10.69	12.14	20.79
145	4.75	5.19	5.78	6.52	7.52	8.63	9.83	10.91	11.95	19.68
150	5.58	6.08	6.65	7.46	8.32	9.27	10.24	11.07	11.91	18.65
155	6.56	7.06	7.67	8.33	9.04	9.79	10.52	11.20	11.88	17.62
160	7.66	8.11	8.59	9.10	9.64	10.22	10.71	11.24	11.77	16.46
165	8.69	9.04	9.41	9.80	10.23	10.56	10.92	11.29	11.65	15.17
170	9.61	9.84	10.09	10.31	10.53	10.76	10.99	11.21	11.44	13.76
175	10.32	10.41	10.52	10.62	10.73	10.84	10.96	11.07	11.18	12.35
180	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00

Vert. Angles	Horizontal Angles									
	100	105	110	115	120	125	130	135	140	145
0	11.18	11.18	11.18	11.18	11.18	11.18	11.18	11.18	11.18	11.18
5	13.49	14.49	15.46	16.40	17.30	18.15	18.95	19.70	20.38	20.99
10	15.85	17.83	19.76	21.63	23.47	26.51	29.46	32.21	34.73	37.01
15	18.15	21.14	24.20	29.25	34.12	38.77	43.17	47.95	52.84	57.27
20	20.19	24.29	31.01	37.59	44.02	51.80	59.50	66.72	73.33	79.61
25	22.12	29.06	37.14	45.39	55.19	64.77	74.84	85.12	94.35	102.47
30	24.06	33.51	42.91	54.29	65.57	78.02	90.99	103.76	115.58	125.54
35	27.00	37.73	49.62	62.70	75.71	88.69	105.70	122.53	136.24	147.49
40	29.83	41.66	56.06	70.69	85.18	101.63	120.96	140.27	155.76	170.62
45	32.34	45.75	62.02	78.20	94.29	111.34	135.01	158.66	181.74	200.12
50	34.62	49.96	67.60	85.28	102.86	123.87	152.97	184.28	210.03	229.57
55	36.65	53.84	72.92	92.18	112.44	139.65	172.59	207.28	230.61	249.58
60	38.62	57.51	78.14	100.76	125.89	151.36	187.70	221.31	247.06	267.08
65	40.38	61.03	84.51	109.54	134.96	161.47	197.35	236.19	261.03	282.32
70	42.30	64.78	89.40	114.87	140.52	168.65	207.22	246.46	272.60	294.70
75	44.05	67.54	91.73	119.08	146.23	174.26	217.20	254.62	281.75	304.06
80	44.70	66.72	94.53	123.04	150.67	177.95	224.30	260.85	288.61	311.16
85	43.43	68.80	97.57	126.01	153.68	180.52	228.11	264.94	292.63	315.42
90	43.91	70.12	98.88	127.52	154.99	181.78	229.20	266.50	294.24	316.75
95	44.50	71.02	99.41	127.58	155.11	181.89	229.20	266.06	293.81	316.32
100	44.39	70.12	97.92	126.44	153.78	181.08	226.80	262.85	290.42	312.82
105	44.03	68.56	95.80	123.72	150.66	178.57	220.80	257.75	284.57	306.48
110	42.44	64.95	91.80	119.59	146.36	174.59	212.36	250.74	276.43	297.84
115	40.73	61.28	85.28	112.13	139.74	168.00	203.80	241.58	265.85	286.35
120	39.06	57.95	78.63	101.76	128.10	156.52	193.59	227.60	253.26	272.84
125	37.32	54.49	73.59	92.92	113.33	141.47	175.45	211.70	236.64	256.44
130	35.39	50.72	68.38	86.08	103.66	124.46	152.71	185.01	212.17	234.12
135	33.23	46.64	62.92	79.10	95.10	111.62	134.28	156.39	180.52	199.30

IES INDOOR REPORT
PHOTOMETRIC FILENAME : L022111002.IES

CANDELA TABULATION - (Cont.)

140	30.84	42.63	57.03	71.64	86.07	102.03	120.16	138.46	153.78	168.87
145	28.16	38.87	50.73	63.79	76.66	89.30	105.13	121.03	134.48	145.54
150	25.40	34.81	44.16	55.50	66.73	78.48	90.40	102.46	114.09	124.05
155	23.33	30.51	38.53	46.71	56.23	65.42	74.85	84.49	93.36	101.41
160	21.11	25.79	32.44	38.97	45.35	52.67	59.80	66.45	72.68	78.90
165	18.66	22.09	25.54	30.55	35.35	39.93	44.24	48.76	53.28	57.34
170	16.06	18.32	20.52	22.66	24.77	27.71	30.52	33.09	35.40	37.44
175	13.51	14.65	15.76	16.84	17.88	18.86	19.79	20.66	21.45	22.17
180	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00

**Vert.
Angles**

Horizontal Angles

	<u>150</u>	<u>155</u>	<u>160</u>	<u>165</u>	<u>170</u>	<u>175</u>	<u>180</u>
0	11.18	11.18	11.18	11.18	11.18	11.18	11.18
5	21.53	21.99	22.37	22.66	23.05	23.04	23.02
10	39.03	40.79	42.25	43.40	44.24	44.91	44.92
15	61.21	64.63	67.48	69.75	71.40	72.74	72.79
20	85.18	90.01	94.07	97.29	99.60	101.44	101.47
25	109.63	115.80	120.99	125.16	128.19	129.91	130.46
30	134.07	141.25	147.34	152.20	155.69	157.68	158.22
35	157.51	166.16	173.27	178.86	182.72	184.86	185.33
40	183.05	194.75	207.92	218.56	225.94	229.92	231.01
45	217.68	235.35	244.78	252.17	257.74	261.15	262.17
50	245.84	258.28	268.91	277.12	283.04	286.42	287.18
55	265.36	279.43	291.17	300.10	306.77	310.64	311.52
60	284.62	299.43	311.71	321.74	329.14	333.64	334.54
65	300.87	316.68	329.80	340.37	348.09	352.81	353.51
70	313.60	330.43	344.37	355.38	363.55	368.73	370.03
75	323.59	341.01	355.55	366.92	375.05	380.95	382.57
80	331.43	348.85	363.29	374.86	383.44	389.13	391.40
85	336.25	353.92	369.07	380.84	388.52	393.24	396.85
90	337.63	355.31	370.41	382.15	390.60	395.96	397.62
95	336.98	354.58	369.34	380.60	388.01	392.54	395.84
100	332.84	349.95	363.93	374.97	383.09	387.84	390.53
105	325.48	342.34	356.46	367.39	374.89	380.35	382.32
110	316.04	332.23	345.76	356.48	364.08	369.09	370.76
115	304.18	319.49	332.27	342.53	350.19	354.55	356.06
120	289.74	304.16	316.23	325.88	333.17	337.37	338.80
125	272.75	286.45	298.24	306.94	313.26	317.06	318.58
130	251.77	265.44	276.84	285.07	291.11	294.90	296.37
135	219.16	238.25	248.80	257.18	263.50	267.61	269.05
140	181.09	193.01	207.25	218.22	225.73	229.84	231.08
145	155.25	164.14	171.10	176.25	180.09	182.34	182.99
150	132.54	139.64	145.48	150.08	153.46	155.51	156.20
155	108.50	114.63	119.70	123.66	126.52	128.35	129.02
160	84.42	89.14	93.06	96.13	98.44	100.36	100.49
165	60.99	64.21	66.94	69.22	70.92	72.32	72.44
170	39.18	40.79	42.12	43.17	43.91	44.51	44.50
175	22.80	23.35	23.80	24.16	24.62	24.62	24.62
180	10.00	10.00	10.00	10.00	10.00	10.00	10.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : L022111002.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	9.51	N.A.	0.80
0-30	29.59	N.A.	2.60
0-40	66.95	N.A.	5.90
0-60	211.85	N.A.	18.50
0-80	439.28	N.A.	38.40
0-90	569.40	N.A.	49.80
10-90	567.86	N.A.	49.60
20-40	57.44	N.A.	5.00
20-50	117.91	N.A.	10.30
40-70	250.72	N.A.	21.90
60-80	227.43	N.A.	19.90
70-80	121.61	N.A.	10.60
80-90	130.13	N.A.	11.40
90-110	253.17	N.A.	22.10
90-120	360.49	N.A.	31.50
90-130	446.64	N.A.	39.00
90-150	545.07	N.A.	47.60
90-180	574.75	N.A.	50.20
110-180	321.59	N.A.	28.10
0-180	1144.16	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	1.55
10-20	7.96
20-30	20.09
30-40	37.36
40-50	60.47
50-60	84.43
60-70	105.82
70-80	121.61
80-90	130.13
90-100	130.52
100-110	122.64
110-120	107.32
120-130	86.15
130-140	61.18
140-150	37.25
150-160	20.09
160-170	8.03
170-180	1.57

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56	50
1	92	85	79	73	84	78	72	67	64	60	56	52	48	46	40	38	36	30
2	81	71	63	55	74	65	57	51	53	47	42	42	38	34	32	29	26	21
3	73	61	51	43	66	55	47	40	45	38	33	35	30	26	27	23	19	15
4	66	52	43	35	59	48	39	32	39	32	26	30	25	21	23	19	15	11
5	60	46	36	29	54	42	33	27	34	27	22	27	21	17	20	16	12	9
6	55	41	31	24	49	37	28	22	30	23	18	24	18	14	18	13	10	7
7	50	36	27	21	45	33	25	19	27	20	15	21	16	12	16	12	8	6
8	46	33	24	18	42	30	22	16	24	18	13	19	14	10	14	10	7	5
9	43	29	21	15	39	27	19	14	22	16	11	17	12	9	13	9	6	4
10	40	27	19	14	36	25	17	12	20	14	10	16	11	8	12	8	5	3


IES INDOOR REPORT
PHOTOMETRIC FILENAME : L022111002.IES

UGR TABLE - CORRECTED

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	0.5	0.5	0.5	0.5	0.5	6.3	7.3	7.2	8.3	9.5
	3H	0.5	0.5	0.5	0.5	0.5	7.6	8.6	8.5	9.5	10.8
	4H	0.5	0.5	0.5	0.5	1.6	8.1	9.0	9.0	10.0	11.3
	6H	0.5	1.3	1.4	2.3	3.6	8.4	9.3	9.4	10.3	11.6
	8H	1.5	2.3	2.5	3.3	4.6	8.6	9.4	9.5	10.4	11.7
	12H	2.7	3.5	3.6	4.5	5.8	8.7	9.5	9.6	10.5	11.8
4H	2H	0.5	0.5	0.5	0.5	0.5	12.4	13.3	13.3	14.3	15.6
	3H	0.5	0.5	0.5	0.5	0.5	13.8	14.6	14.8	15.6	16.9
	4H	0.5	0.5	0.5	0.6	1.9	14.4	15.1	15.3	16.1	17.4
	6H	0.9	1.6	1.9	2.6	4.0	14.7	15.4	15.7	16.4	17.7
	8H	2.1	2.7	3.0	3.7	5.1	14.8	15.5	15.8	16.5	17.8
	12H	3.3	3.9	4.3	5.0	6.3	14.9	15.5	15.9	16.5	17.8
8H	4H	0.5	0.5	0.5	0.6	1.9	17.7	18.4	18.7	19.4	20.7
	6H	1.1	1.7	2.1	2.8	4.1	18.4	19.0	19.4	20.0	21.3
	8H	2.4	2.9	3.4	3.9	5.3	18.6	19.2	19.6	20.2	21.5
	12H	3.7	4.2	4.8	5.2	6.6	18.8	19.3	19.8	20.3	21.7
12H	4H	0.5	0.5	0.5	0.5	1.9	18.7	19.3	19.7	20.4	21.7
	6H	1.2	1.7	2.2	2.7	4.1	19.7	20.2	20.7	21.2	22.6
	8H	2.4	2.9	3.4	3.9	5.3	20.1	20.6	21.1	21.6	23.0

Maximum UGR = 23.0

POLAR GRAPH

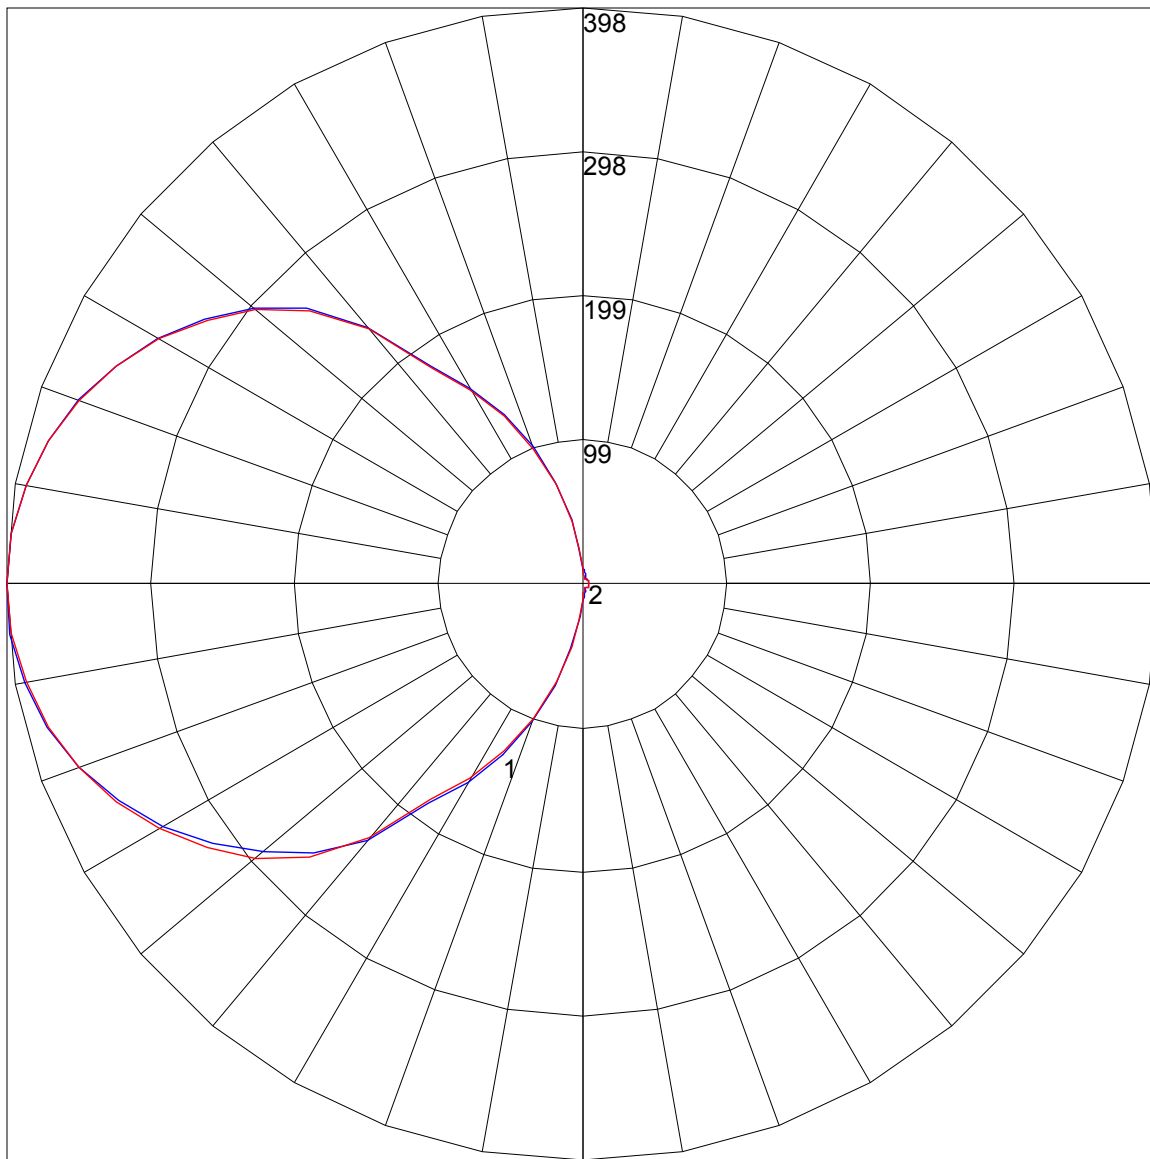

Maximum Candela = 397.62 Located At Horizontal Angle = 180, Vertical Angle = 90
1 - Vertical Plane Through Horizontal Angles (180 - 0) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (90) (Through Max. Cd.)